



The Signalizer™

Model EMP - US Patent No. 11,041,738




Building or Factory Automation Controls



AWWA C707-05 COMPLIANT

2 YEAR WARRANTY

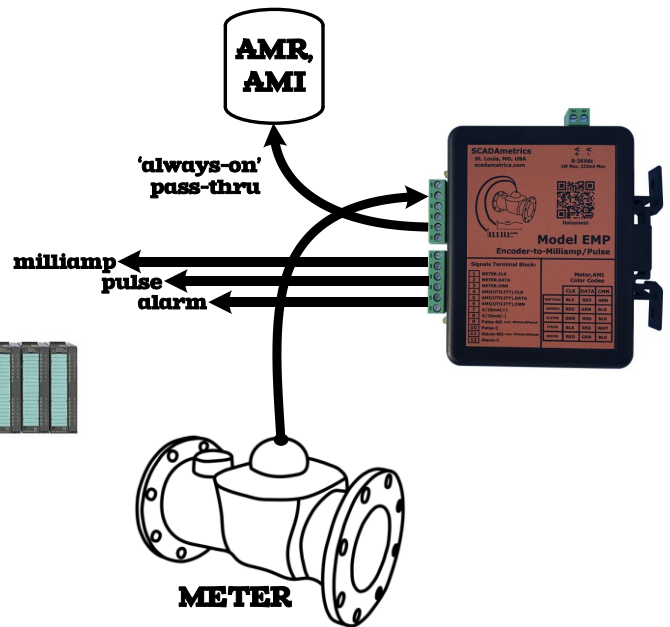

The Versatile 4-20 Milliamp and Pulse Signal Source for Master Meter Water Meters!

SCADAMetrics® is pleased to introduce the newest member of its DINstrumentation™ series – **The Signalizer™!**

This new electronic signal generator for water meters provides a 4-20 milliamp (flow) output and a dry contact pulse (per volume) output! – while still maintaining the meter’s ability to be co-connected to an AMI/AMR endpoint!

Meter Owners have traditionally been required to make a weighted buying decision: encoder-type meter?... or milliamp/pulse-type meter? **The Signalizer** allows you to easily have both with the same meter!

The Signalizer utilizes the popular encoder signal from the water meter to generate both a 4-20mA rate-of-flow signal¹ and a dry-contact pulse-per-volume signal. ...And because **The Signalizer** is outfitted with an integral pass-thru port, it can co-exist with an AMI/AMR system². Even if power is removed, the pass-thru port is always functional – ensuring continuous connectivity to the AMR/AMI system!

The Signalizer is compatible with the Octave, MMT, and BLMJ registers by Master Meter (Mansfield, TX).


Key Features -

- 4-20mA Flow-Proportional Output (3KV Isolation).
- Dry-Contact, Volume-Proportional Output (3.75KV Isolation).
- Dry-Contact Alarm Output (3.75KV Isolation).
- Built-In Pass-Thru Port for Co-Connection to an AMI/AMR System – Works Even If Power Down!
- Compatible with 3-wire version Sensus registers.
- Works with All Popular Registration Units (Gallons, Cubic Feet, Cubic Meters, Acre Feet).
- No Computer Required! – Setup via DIP Switches Only!
- Removable Terminal Blocks, Simplified Wiring Procedures.
- Mounts on standard 35mm industrial DIN-rail.
- 24VDC-Powered (1.5KV Isolation). Low 1.2W Power Consumption.
- Enclosure and Circuit Board: UL 94-V0 recognized materials.
- Simulation-Mode Feature: Emits 12mA and 1 Hz Pulse.

Are you interested in how SCADAMetrics meter technology can help you more closely monitor the flow through your water meters? Give us a call! We’ll be glad to discuss the details!

¹**Encoder Resolution** – a high-fidelity 4-20mA signal requires high-resolution encoder resolution (8+ digits). Therefore, for optimal 4-20mA SIGNALIZER performance, we recommend the Octave/AccuLinx/eLinx register be pre-programmed to transmit eight (8) totalizer digits.

²**Permitting** – If the meter is owned by the water utility, we recommend that you first contact its engineering department for permission!

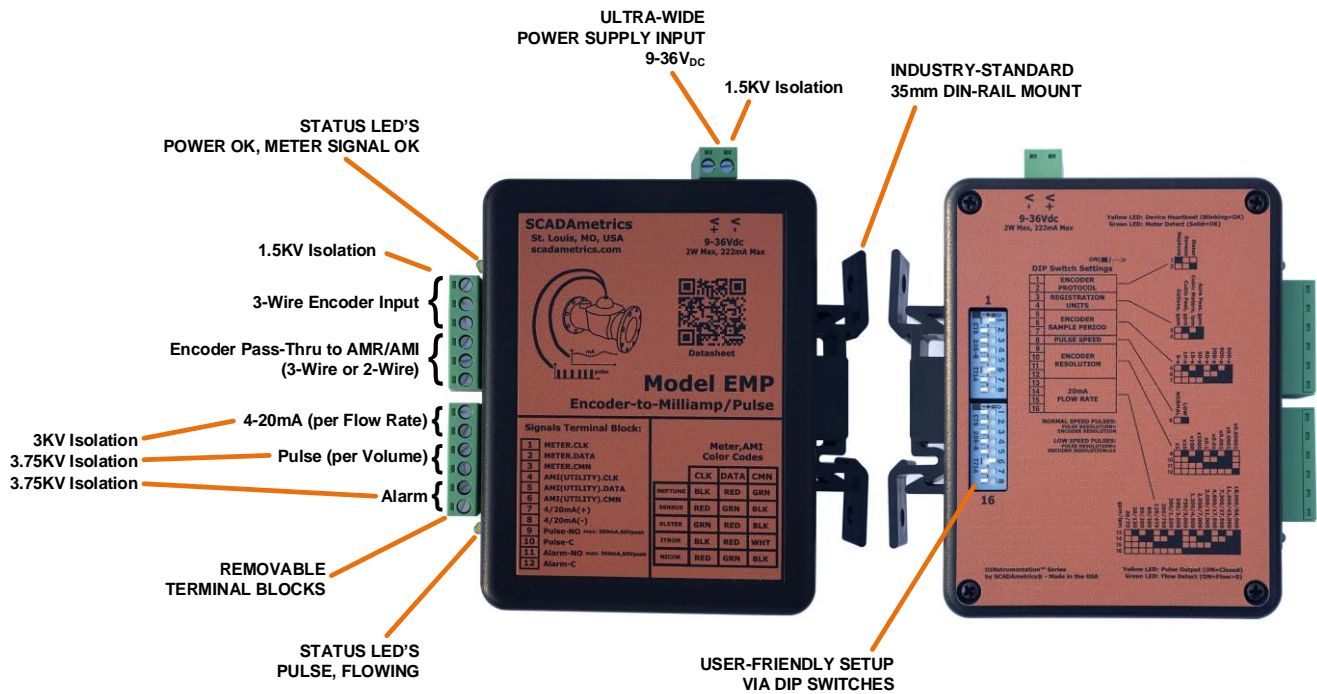

Engineering Specifications -

Dimensions: 4.5" x 5.0" x 1.275"
 Weight: 6.5 Ounces
 Supply Voltage: 9-36V_{DC}
 Supply Power: 1.25W
 Power Supply Isolation: 1500V_{RMS}

Neptune Protocol Support: Yes, 8,9-Digit "MACH-10/ProCoder/E-CODER", and 6-Digit "ProRead" Protocols
 Sensus Protocol Support: Yes, Both Fixed and Variable Digit Sensus Protocols (4-9 digits)
 Elster Protocol Support: Yes, Auto-Fills Units and Decimal Shift, Based on Embedded Info within Elster K-Frame
 AMI Pass-Thru Port Support: Universal - Works with All Major-Brand AMI/AMR Endpoints:
 Neptune, Sensus, Aclara, Badger, Metron-Farnier, Itron, Master Meter, Hersey/Mueller, RG3, Zenner, Honeywell, Kamstrup, SCADAmetrics, Touchpads (All), Remote Displays (All)

Supported Units: Gallon, Cubic Feet, Cubic Meters, Acre-Feet
 Supported Scalars: x1, x10, x100, x1,000 --- x0.1, x0.01, x0.0001, x0.00001
 Encoder Sample Period (s): 5, 10, 15, 30, 60, 300, 600, 900 (User-Selectable)
 Programming Method: Integrated DIP Switches, 16-Poles


4-20mA Flow Range (gpm): 20,30,50,80,125,200,300,500,750,1200,2000,3000,4600,7300,11400,18000
 4-20mA Flow Range (lpm): 75,120,200,300,475,750,1200,2000,3000,4500,7000,11000,17500,27500,43000,68000
 4-20mA Resolution: 16-Bit DAC
 4-20mA Isolation: 3000V_{RMS}
 4-20mA Max Series Resistance: 500 Ω
 4-20mA Signal Type: Active. Therefore, do not add an external loop supply, or else damage to the unit will result!

Pulse Output Type: Solid-State Dry-Contact, 1 Pulse-per-Encoder Resolution
 Contact Closure Duration: 50% Duty Cycle or 1000ms - whichever is less
 Alarm Output Type: Solid-State Dry-Contact, Closes if Meter or Signalizer Fault
 Pulse Resolution: Normal-Speed Mode: Pulse Resolution = Encoder Resolution
 Low-Speed Mode: Pulse Resolution = Encoder Resolution / 10
 Closed-Contact Resistance: 0.4 ohm, typical
 Closed-Contact Max Current: 500mA
 Open-Contact Max Voltage: 60V
 Pulse/Alarm Isolation: 3750V_{RMS}

Meter Cable Connection: 3-Position, Removable Screw-Down Terminal Block, 12-26 AWG
 Pass-Thru Cable Connection: 3-Position, Removable Screw-Down Terminal Block, 12-26 AWG
 Pass-Thru Port for AMR/AMI: Yes, Supports both 3-Wire and 2-Wire AMR Devices

Temperature: -40C to 85C (-40°F to 185°F)
 Relative Humidity: 5% to 95%, Non-Condensing
 Enclosure Rating: Built to IP40 Specifications, Not Rated for Submersion/Outdoor Use
 Manufacturing Location: USA
 Environmental: ROHS-Compliant, Lead-Free
 Meter Interface: AWWA C707-05
 Warranty: 2 Years (see www.scadametrics.com for details)

Engineering Dimensions (Inches) -

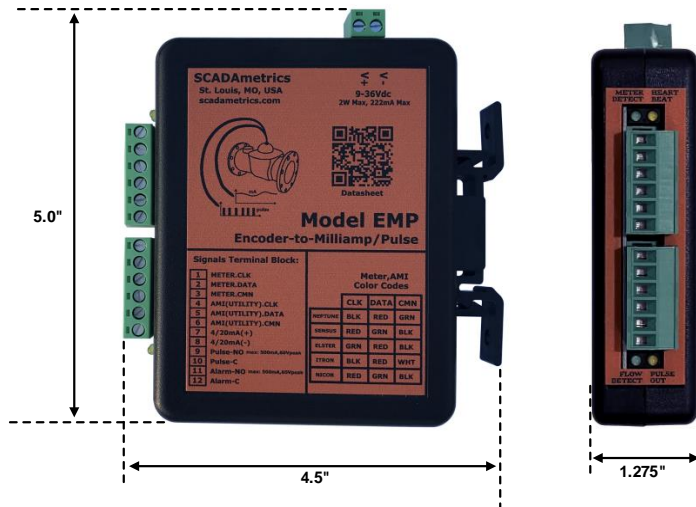

Meter Terminal Block Hookup -

Term.	Function	Master Meter with Standard Cable	Master Meter with Nicor Cable	Master Meter With Itron ERT Cable
1	Meter Clock	Red	Red	Black
2	Meter Data	Green	Green	Red
3	Meter Ground	Black	Black	White Shield

AMR/AMI Terminal Block Hookup -

Term.	Function	Master Meter, Sensus, Metron-Farnier, Badger, Kamstrup, Mueller, Zenner, RG3, Nicor Cable)	Neptune Color	Elster Color	Itron ERT Cable
4	Utility AMI Clock	Red	Black	White Green	Black
5	Utility AMI Data	Green White	Red	Red	Red
6	Utility AMI Ground	Black	Green	Black	White Shield

Wiring Notes:

1. Meter Terminal Block Hookup (Terminals 1,2,3): Apply the color-coding that pertains to the manufacturer of the Water Meter (or manufacturer of the Specialty Cable, such as Nicor or Itron).
2. Utility AMI/AMR Terminal Block Hookup (Terminals 4,5,6): Apply the color-coding that pertains to the manufacturer of the AMI/AMR Endpoint (or manufacturer of the Specialty Cable, such as Nicor or Itron).

Signal Terminal Block Hookup -

Terminal	Function	Notes
7	4-20mA +	Settable Range via DIP Switches
8	4-20mA -	
9	Pulse +	Solid-State Dry Contact (N-O) 500mA Max, 60V Max
10	Pulse -	
11	Alarm +	Solid-State Dry Contact (N-O) 500mA Max, 60V Max
12	Alarm -	

DIP Switch Setup (Also Imprinted on Device Rear Cover) -



9-36Vdc
2W Max, 222mA Max

Yellow LED: Device Heartbeat (Blinking=OK)
Green LED: Meter Detect (Solid=OK)

Simulation Mode

1	Elster	
2	Sensus	
	Neptune	

ON(■) →

DIP Switch Settings

1

1	ENCODER PROTOCOL
2	
3	REGISTRATION UNITS
4	
5	ENCODER SAMPLE PERIOD
6	
7	
8	PULSE SPEED
9	ENCODER RESOLUTION
10	
11	
12	
13	20mA FLOW RATE
14	
15	
16	

Registration Units

1	Acre Ft, gpm
2	M ³ , lpm
3	Ft ³ , gpm
4	Gallons, gpm

Encoder Sample Period

5	900-s
6	600-s
7	300-s
	60-s
	30-s
	15-s
	10-s
	5-s

Pulse Speed

8	NORMAL
	LOW

Encoder Resolution

9	X0.00001
10	X0.0001
11	X0.001
12	X0.01
	X0.1
	X100
	X1000
	X10
	X1

NORMAL SPEED PULSES:
PULSE RESOLUTION= ENCODER RESOLUTION

LOW SPEED PULSES:
PULSE RESOLUTION= ENCODER RESOLUTIONx10


SIMULATION MODE:
PULSE OUTPUT: 1 Hz
FLOW SIGNAL OUTPUT: 12mA

16

20mA Flow Rate

13	18,000/68,000
14	11,400/43,000
15	7,300/27,500
16	4,600/17,500
	3,000/11,000
	2,000/7,000
	1,200/4,500
	750/3,000
	500/2,000
	300/1,200
	200/750
	125/475
	80/300
	50/200
	30/120
	20/75

QUICK-START GUIDE -

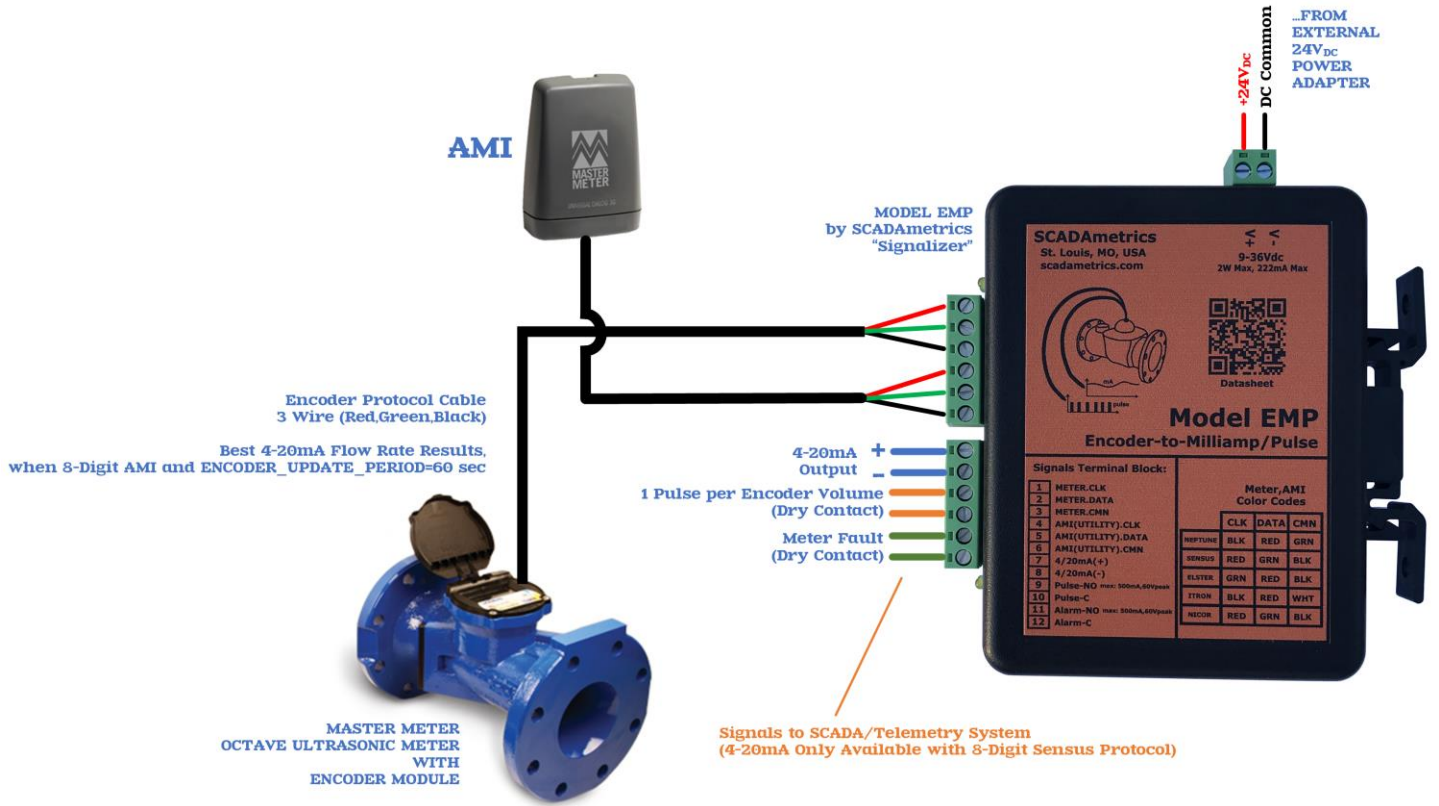

WIRING FOR: MASTER METER OCTAVE, MMT, BLMJ WATER METERS

Fig1

Initial Setup:

- 1. Attach the water meter's three (3) encoder wires to Signalizer terminals 1,2,3 (see above table for color-coding).**
- 2. (If Applicable) Attach the AMR/AMI endpoint's three (3) encoder wires to Signalizer terminals 4,5,6 (see above table for color-coding).**
- 3. (If Applicable) Connect the 4-20mA output signal to PLC/Controller: Terminals 7(+) and 8(-). Important Note! – The Signalizer™ provides loop power. The user must not add an additional loop power supply, or else damage to the unit will result.**
- 4. (If Applicable) Connect the pulse output signal to the PLC/Controller: Terminals 9 and 10. Important Note! – The pulse output is a solid-state, dry-contact type. 500mA max, 60V max. Circuit must be current-limited by external means.**
- 5. (If Applicable) Connect the alarm output signal to the PLC/Controller: Important Note! – The alarm output is a solid-state, dry-contact type. 500mA max, 60V max. Circuit must be current-limited by external means.**
- 6. Set the DIP Switches, per the Datasheet. Master Meter Encoded Meters Communicate Using the SENSUS Protocol (DIP Switches 1,2).**
- 7. Connect DC voltage source to the Signalizer's V+/V- terminals. An isolated 24V_{DC} power supply is recommended.**

Apply Power, and Observe...

- The Upper Yellow 'Heartbeat' LED should light up YELLOW, with an OCCASIONAL BLINK, signifying that the Signalizer is working.
- The Upper Green 'Meter OK' LED should light up SOLID GREEN, signifying that the meter has been successfully detected.
- The Lower Yellow LED will follow the Pulse Output (LED ON=Contact Closure).
- The Lower Green LED will light up SOLID GREEN during periods when Positive Flow is Detected.

OCTAVE WATER METERS -

Recommended DIP Switches 1-12 FOR 8-DIGIT OCTAVE METERS:

Size	Gallon	Cubic Feet	Cubic Meters	
1.5" 2" 3" 4"	DipSw.1= DipSw.2= DipSw.3= DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 1 Gal Low Speed Pulse: 1 Pulse / 10 Gal	DipSw.1= DipSw.2= DipSw.3=ON DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.1 FT ³ Low Speed Pulse: 1 Pulse / 1 FT ³	DipSw.1= DipSw.2= DipSw.3= DipSw.4=ON DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9=ON DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.01 M ³ Low Speed Pulse: 1 Pulse / 0.1 M ³	<p style="text-align: center;">For Octave Meters, ENCODER_UPDATE_PERIOD (Octave Setting) Should be Set to 60 Seconds. Resultant 4-20mA Update Rate = 60s. If Faster Updates Are Required, Then the Model APK Should be Used In Conjunction with a Dual-Output Octave (Encoder+Open Drain Pulse).</p>
6" 8" 10" 12"	DipSw.1= DipSw.2= DipSw.3= DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9=ON DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 10 Gal Low Speed Pulse: 1 Pulse / 100 Gal	DipSw.1= DipSw.2= DipSw.3=ON DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 1 FT ³ Low Speed Pulse: 1 Pulse / 10 FT ³	DipSw.1= DipSw.2= DipSw.3= DipSw.4=ON DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.1 M ³ Low Speed Pulse: 1 Pulse / 1 M ³	

MMT and BLMJ METERS with ACCULINX -

Recommended DIP Switches 1-12 FOR 8-DIGIT ACCULINX REGISTERS:

Size	Gallon	Cubic Feet	Cubic Meters
5/8" 3/4" 1"	DipSw.1= DipSw.2= DipSw.3= DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.1 Gal Low Speed Pulse: 1 Pulse / 1 Gal	DipSw.1= DipSw.2= DipSw.3=ON DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9=ON DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.01 FT ³ Low Speed Pulse: 1 Pulse / 0.1 FT ³	DipSw.1= DipSw.2= DipSw.3= DipSw.4=ON DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10=ON DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.001 M ³ Low Speed Pulse: 1 Pulse / 0.01 M ³
1.5" 2" 3" 4"	DipSw.1= DipSw.2= DipSw.3= DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 1 Gal Low Speed Pulse: 1 Pulse / 10 Gal	DipSw.1= DipSw.2= DipSw.3=ON DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.1 FT ³ Low Speed Pulse: 1 Pulse / 1 FT ³	DipSw.1= DipSw.2= DipSw.3= DipSw.4=ON DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9=ON DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.01 M ³ Low Speed Pulse: 1 Pulse / 0.1 M ³
6" 8" 10" 12"	DipSw.1= DipSw.2= DipSw.3= DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9=ON DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 10 Gal Low Speed Pulse: 1 Pulse / 100 Gal	DipSw.1= DipSw.2= DipSw.3=ON DipSw.4= DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 1 FT ³ Low Speed Pulse: 1 Pulse / 10 FT ³	DipSw.1= DipSw.2= DipSw.3= DipSw.4=ON DipSw.5=ON DipSw.6=ON DipSw.7= DipSw.8= DipSw.9= DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.1 M ³ Low Speed Pulse: 1 Pulse / 1 M ³

**Encoder Sample Period (Dip Switches 5,6,7)
 May Be Set to Any Available Mode:
 5, 10, 15, 30, 60, 300, 600, or 900 seconds,
 As the ACCULINX Does Not Have an Internal
 Battery to Conserve.**

MMT and BLMJ METERS with ELINX -

Recommended DIP Switches 1-12 FOR 8-DIGIT ELINX REGISTERS:

Size	Gallon	Cubic Feet	Cubic Meters	
5/8" 3/4" 1"	DipSw.1= DipSw.2= DipSw.3= DipSw.4= DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9= DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.1 Gal Low Speed Pulse: 1 Pulse / 1 Gal	DipSw.1= DipSw.2= DipSw.3=ON DipSw.4= DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9=ON DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.01 FT ³ Low Speed Pulse: 1 Pulse / 0.1 FT ³	DipSw.1= DipSw.2= DipSw.3= DipSw.4=ON DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9= DipSw.10=ON DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.001 M ³ Low Speed Pulse: 1 Pulse / 0.01 M ³	Encoder Sample Period (Dip Switches 5,6,7) Are Recommended Set to a Relaxed Polling Rate of 300 seconds, as the ELINX Has an Internal Battery.
1.5" 2" 3" 4"	DipSw.1= DipSw.2= DipSw.3= DipSw.4= DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9= DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 1 Gal Low Speed Pulse: 1 Pulse / 10 Gal	DipSw.1= DipSw.2= DipSw.3=ON DipSw.4= DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9= DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.1 FT ³ Low Speed Pulse: 1 Pulse / 1 FT ³	DipSw.1= DipSw.2= DipSw.3= DipSw.4=ON DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9=ON DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.01 M ³ Low Speed Pulse: 1 Pulse / 0.1 M ³	
6" 8" 10" 12"	DipSw.1= DipSw.2= DipSw.3= DipSw.4= DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9=ON DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 10 Gal Low Speed Pulse: 1 Pulse / 100 Gal	DipSw.1= DipSw.2= DipSw.3=ON DipSw.4= DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9= DipSw.10= DipSw.11= DipSw.12= Normal Speed Pulse: 1 Pulse / 1 FT ³ Low Speed Pulse: 1 Pulse / 10 FT ³	DipSw.1= DipSw.2= DipSw.3= DipSw.4=ON DipSw.5=ON DipSw.6= DipSw.7=ON DipSw.8= DipSw.9= DipSw.10= DipSw.11=ON DipSw.12= Normal Speed Pulse: 1 Pulse / 0.1 M ³ Low Speed Pulse: 1 Pulse / 1 M ³	

ALL MASTER METER WATER METERS -

Recommended **DIP Switches 13-16:**

The Following Are *Suggested* Flow Span Settings, and May Need to Be Adjusted Based on Anticipated Max Flow Conditions.

Size	Gallon , Cubic Feet , Cubic Meters
5/8" 20 gpm 75 lpm	DipSw.13= DipSw.14= DipSw.15= DipSw.16=
3/4" 30 gpm 120 lpm	DipSw.13=ON DipSw.14= DipSw.15= DipSw.16=
1" 50 gpm 200 lpm	DipSw.13= DipSw.14=ON DipSw.15= DipSw.16=
1.5" 200 gpm 750 lpm	DipSw.13=ON DipSw.14= DipSw.15=ON DipSw.16=
2" 300 gpm 1200 lpm	DipSw.13= DipSw.14=ON DipSw.15=ON DipSw.16=
3" 750 gpm 3000 lpm	DipSw.13= DipSw.14= DipSw.15= DipSw.16=ON
4" 2000 gpm 7000 lpm	DipSw.13= DipSw.14=ON DipSw.15= DipSw.16=ON
6" 3000 gpm 11000 lpm	DipSw.13=ON DipSw.14=ON DipSw.15= DipSw.16=ON
8" 4600 gpm 17500 lpm	DipSw.13= DipSw.14= DipSw.15=ON DipSw.16=ON
10" 7300 gpm 27500 lpm	DipSw.13=ON DipSw.14= DipSw.15=ON DipSw.16=ON
12" 7300 gpm 27500 lpm	DipSw.13=ON DipSw.14= DipSw.15=ON DipSw.16=ON

4-20mA Span Settings Are Based Solely on Meter Size and Maximum Expected Flow Rates.